



DL-S 50-165/T plus-EN54

- 2-way system
- thermal fuse
- magnetic fastening of grille



EN 54-24:2008
Ref. Nr.: 009-19
ID-Code: SAA-LS09
 1438-CPR-0431

ic audio GmbH, Boehringerstraße 14a,
 D-68307 Mannheim, Germany

CE-Symbol gemäß Richtlinie 93/68EWG

Technical Data (Electrical)

Description	DL-S 50-165/T plus-EN54
Power	50/25/12,5/6,25/ (8) W
Impedance (100V)	200/400/800/1600/ ohm
Frequency Range	65-24.000 Hz
Frequency Response	80-22.200 Hz
SPL IEC268-5, 1W/1m	89,5 dB
SPL EN54-24, Pmax/4m	94,3 dB
Sensitivity EN54-24, 1W/4m	77,5 dB
Sensitivity EN54-24, 1W/1m	89,5 dB
Dispersion -6dB, 500Hz	180°
Dispersion -6dB, 1KHz	180°
Dispersion -6dB, 2KHz	140°

Dispersion -6dB, 4KHz 56°



Technical Data (Mechanical)

Dimensions	264 x 240 mm
IP Rating	IP21
Weight (net)	3,75 kg
Ceiling Cut-out	238 mm
Temperature range	-10 / +55 °C
Mounting	Screw system
Connector	4-pin screw terminal
Terminal diameter	2,5 mm
Maximum cable passage	4,9 mm ²
Colour	RAL 9016


Product Attributes




Technical Diagrams

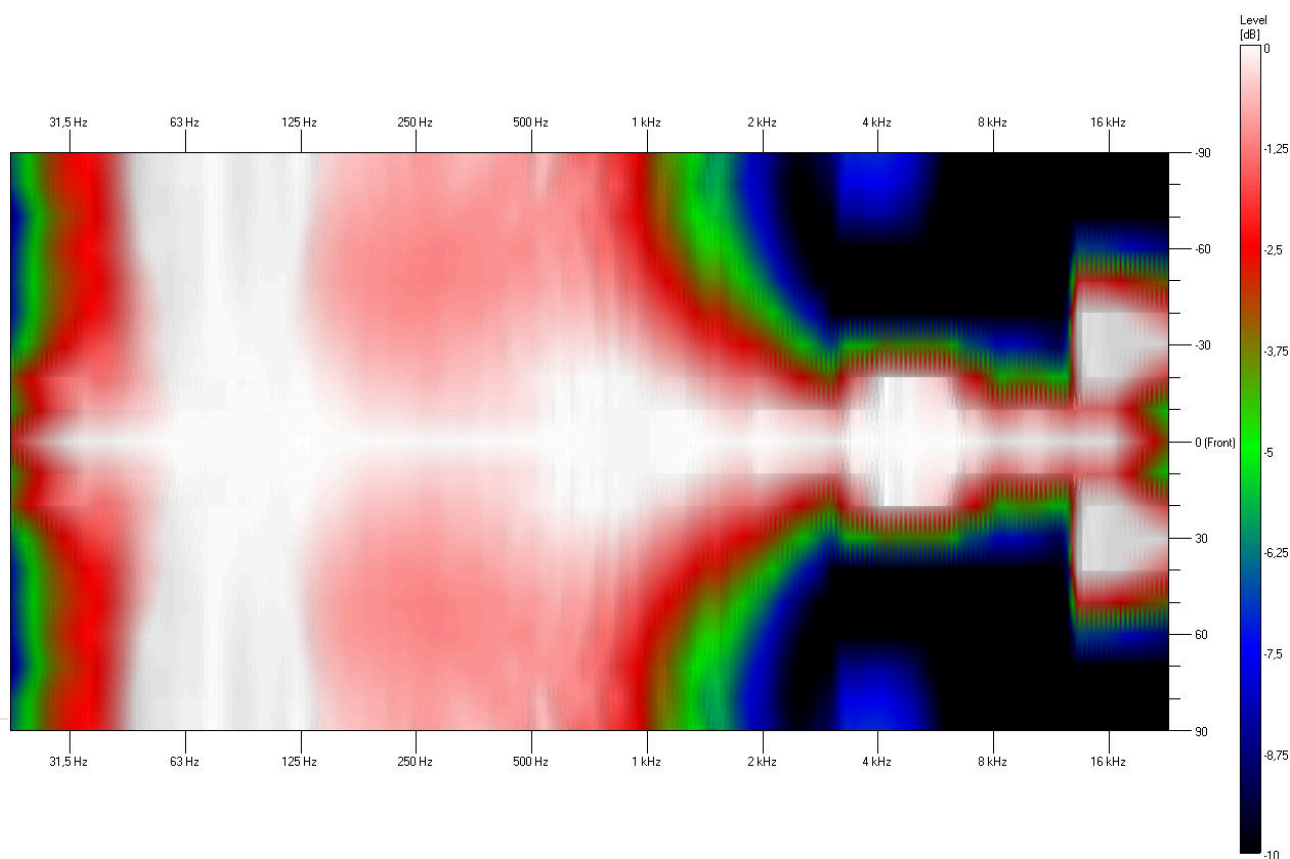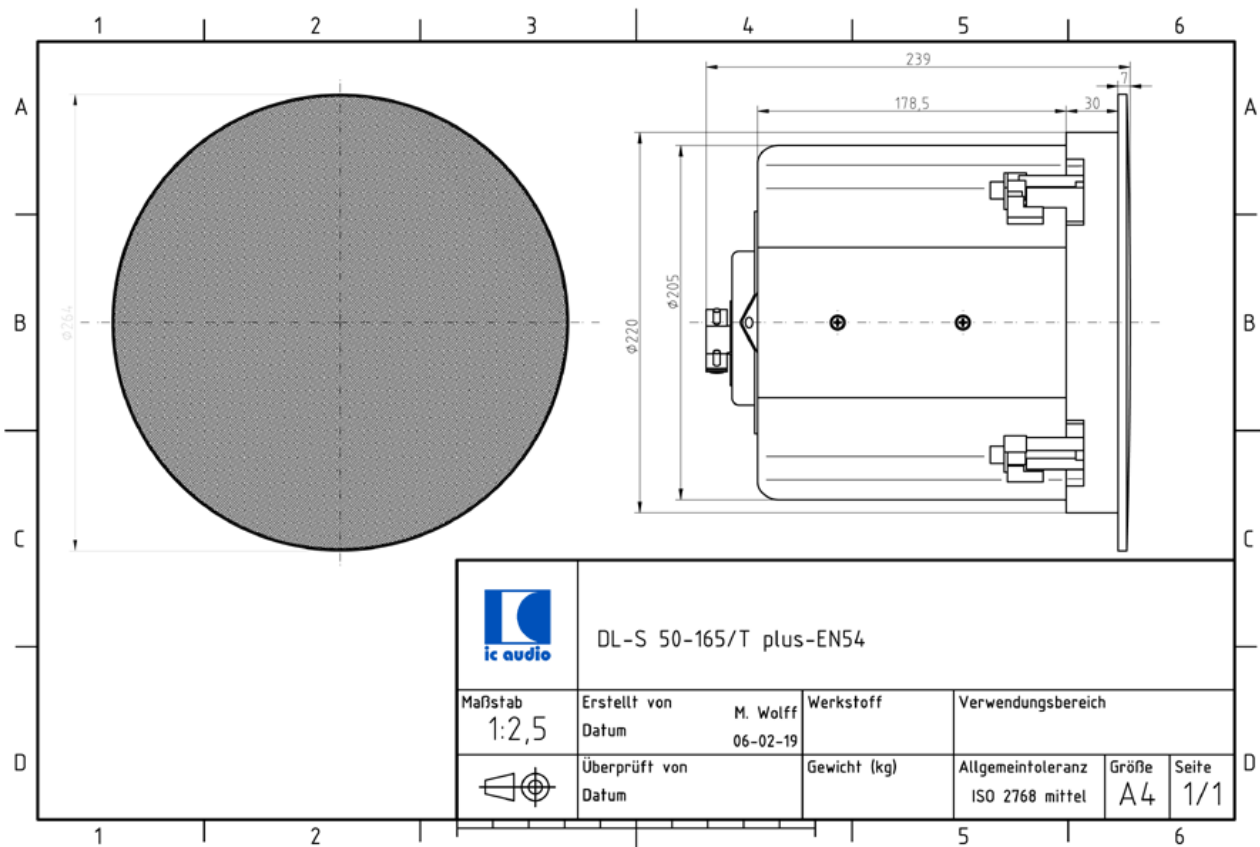



Frequency Response Diagrams

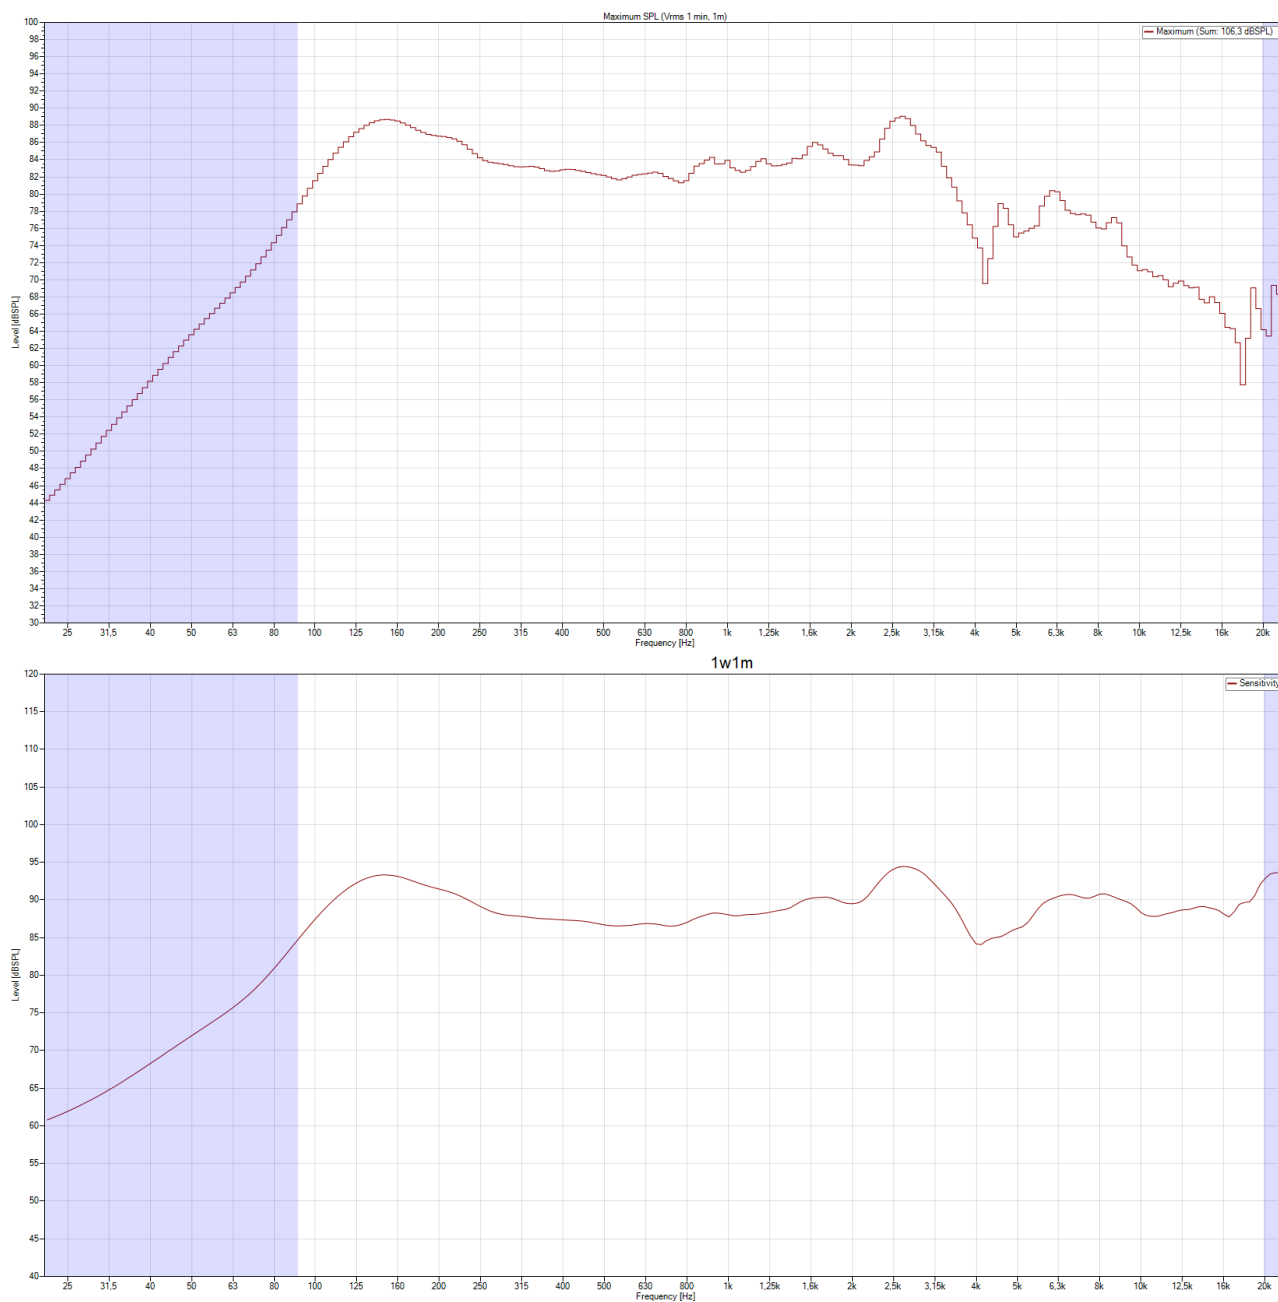



Polar Diagrams

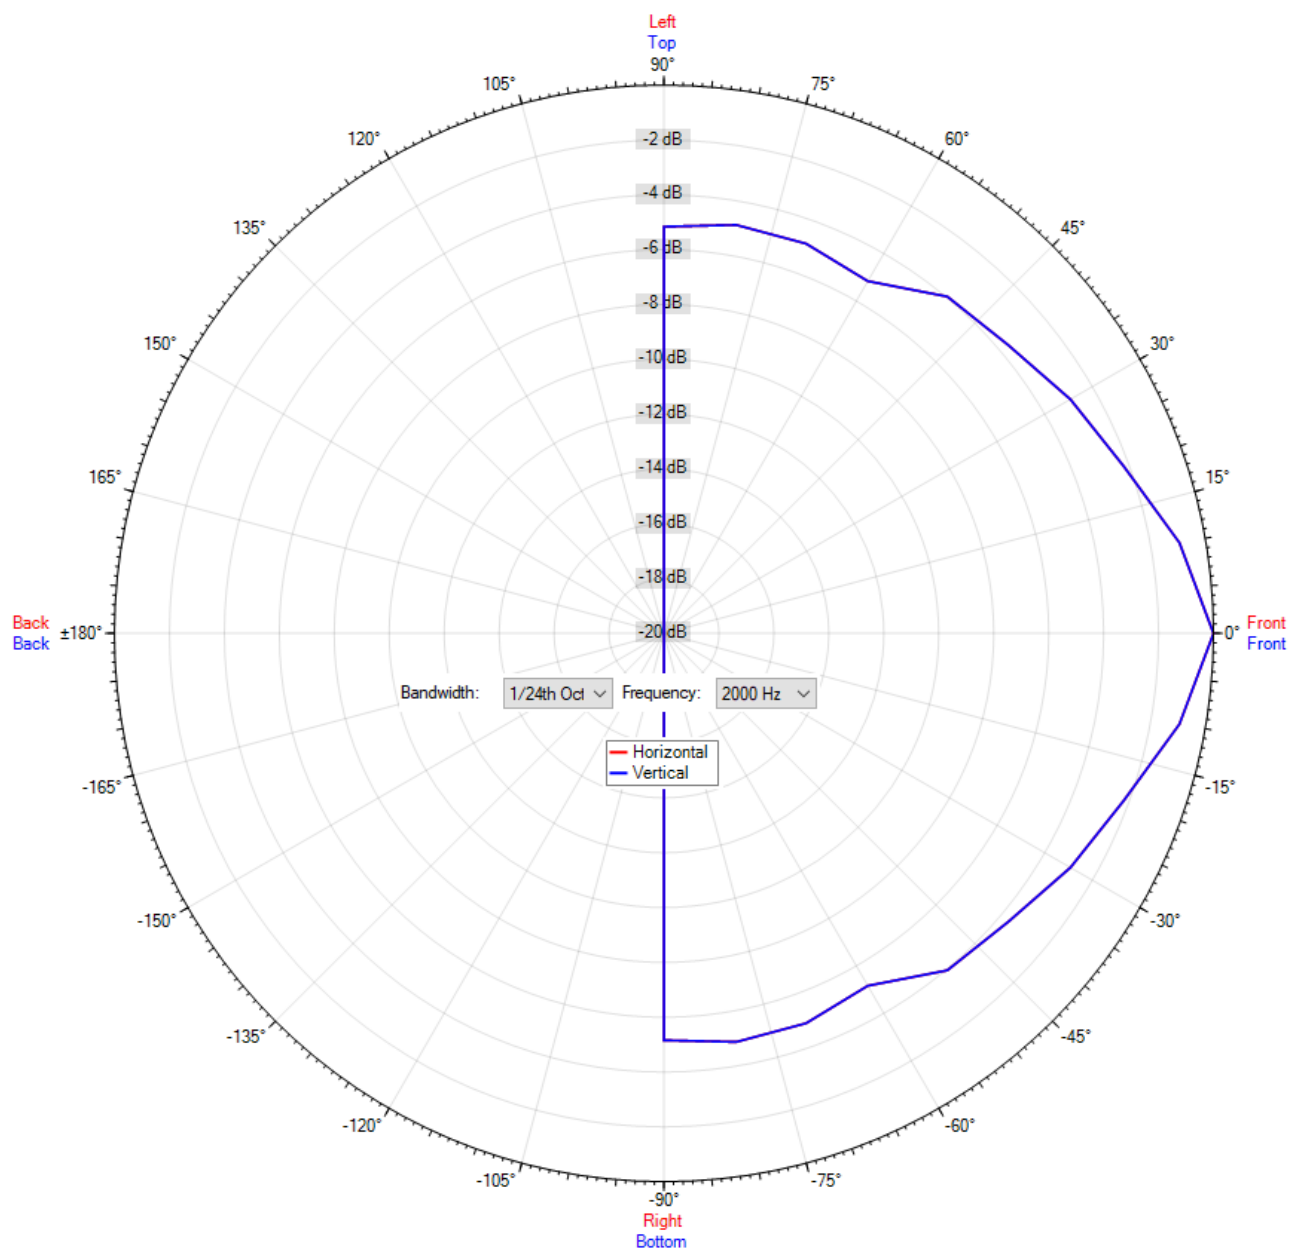

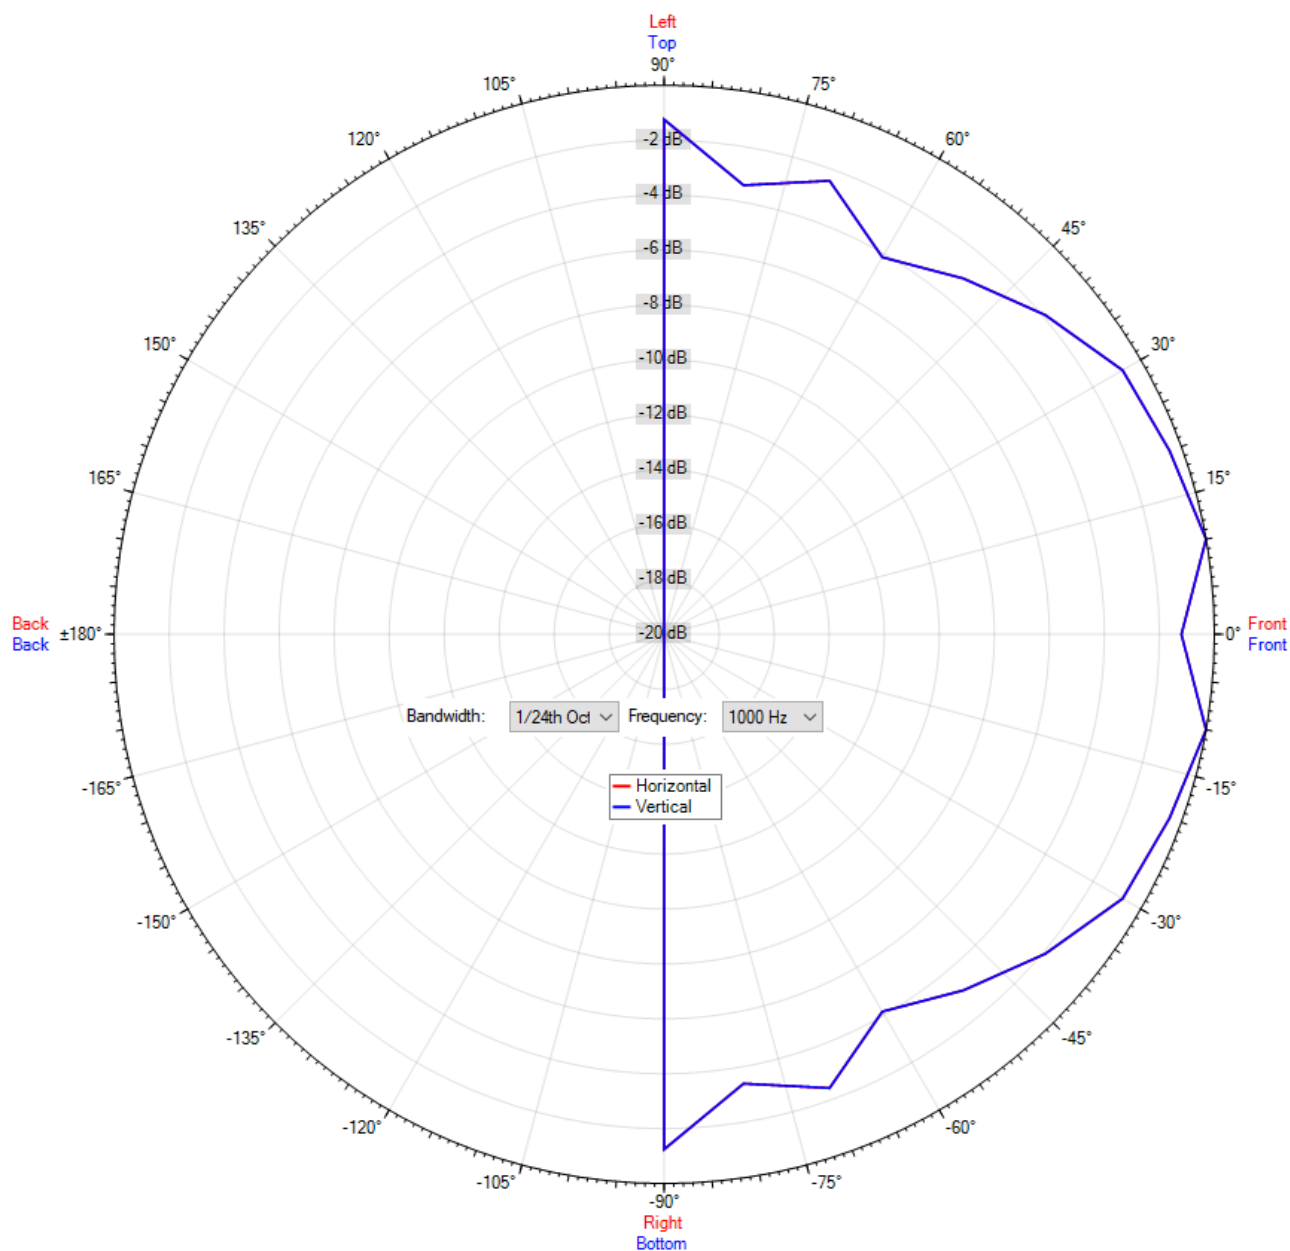

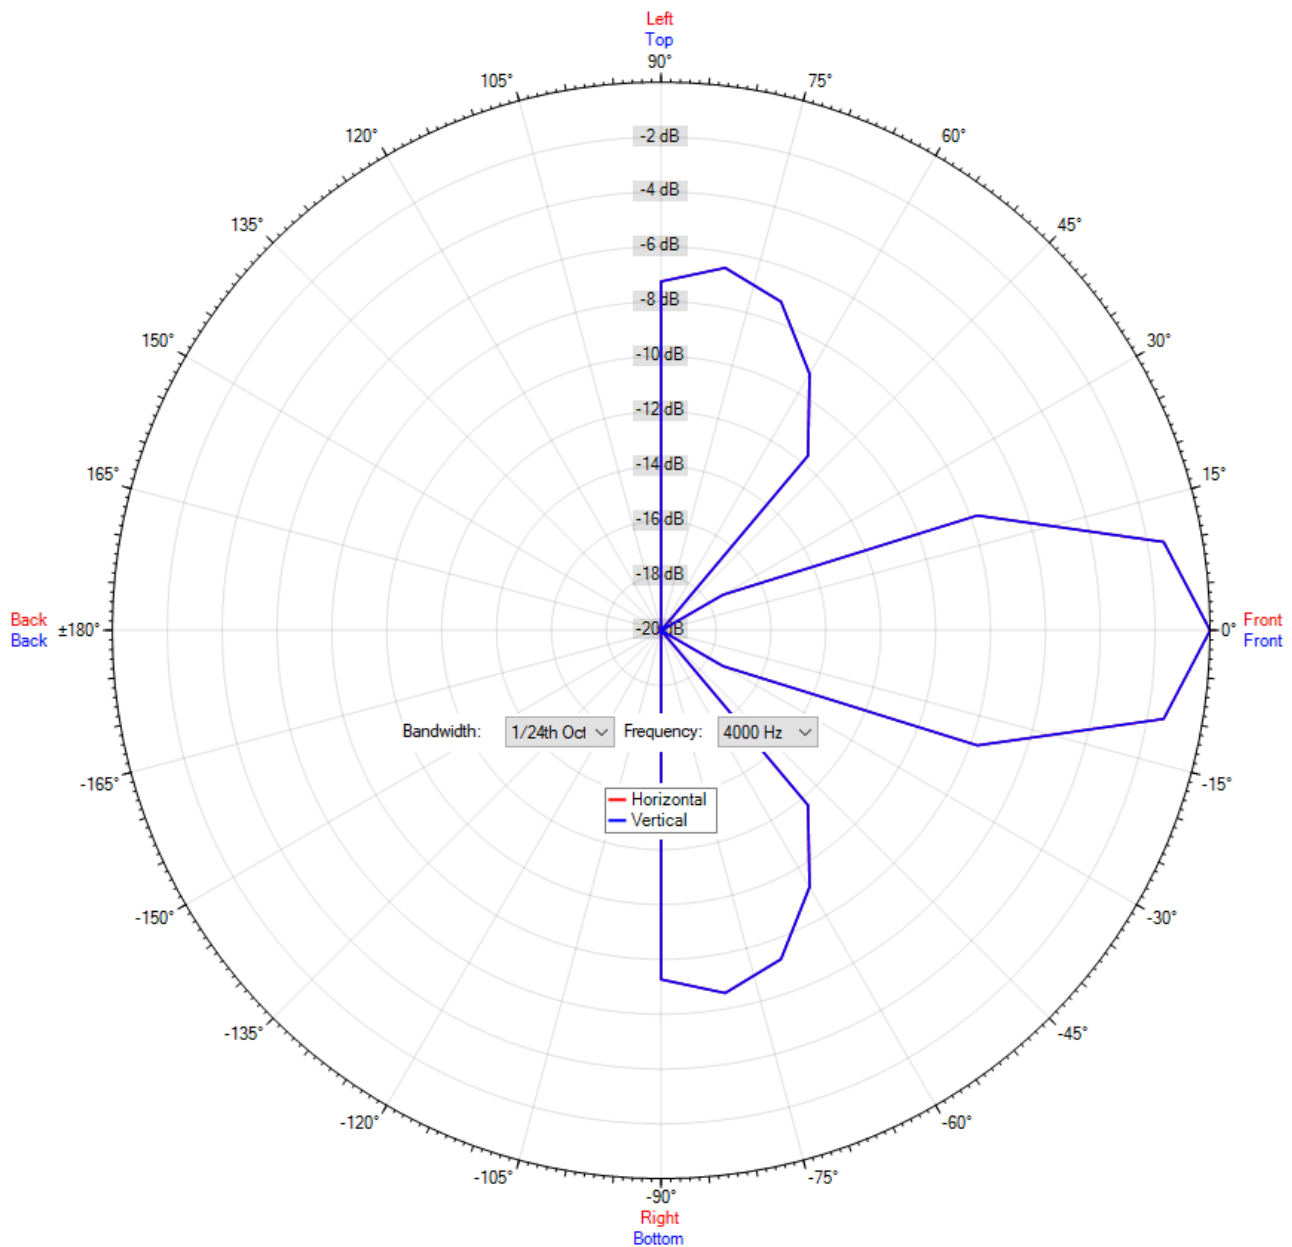

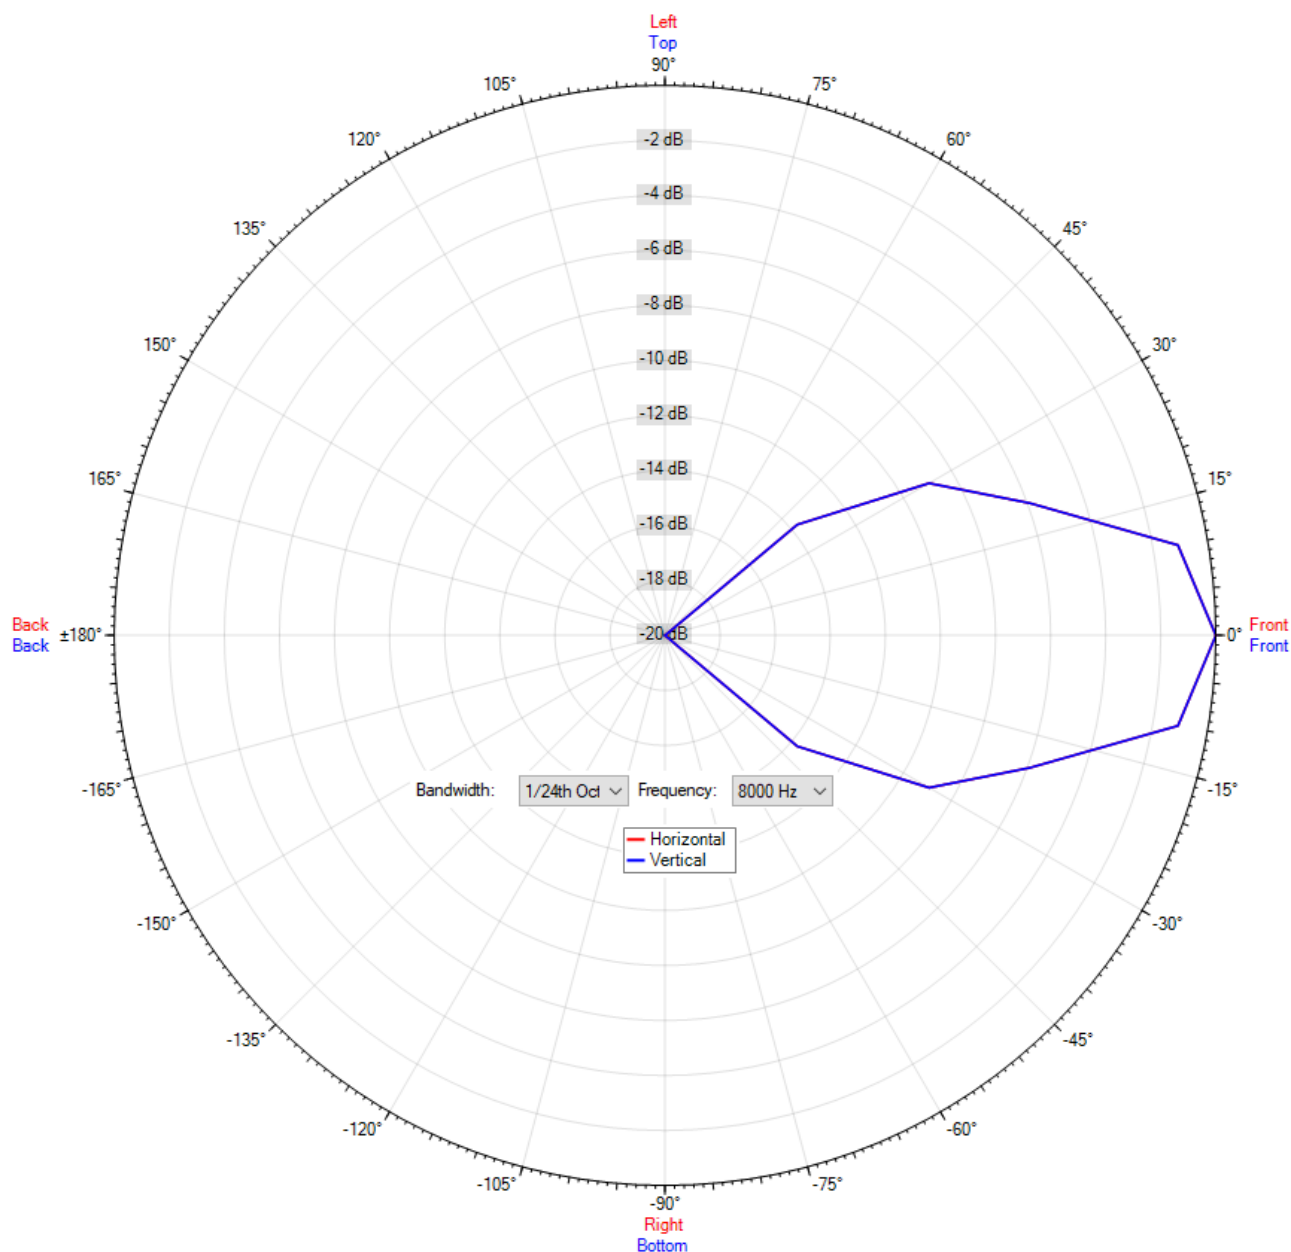

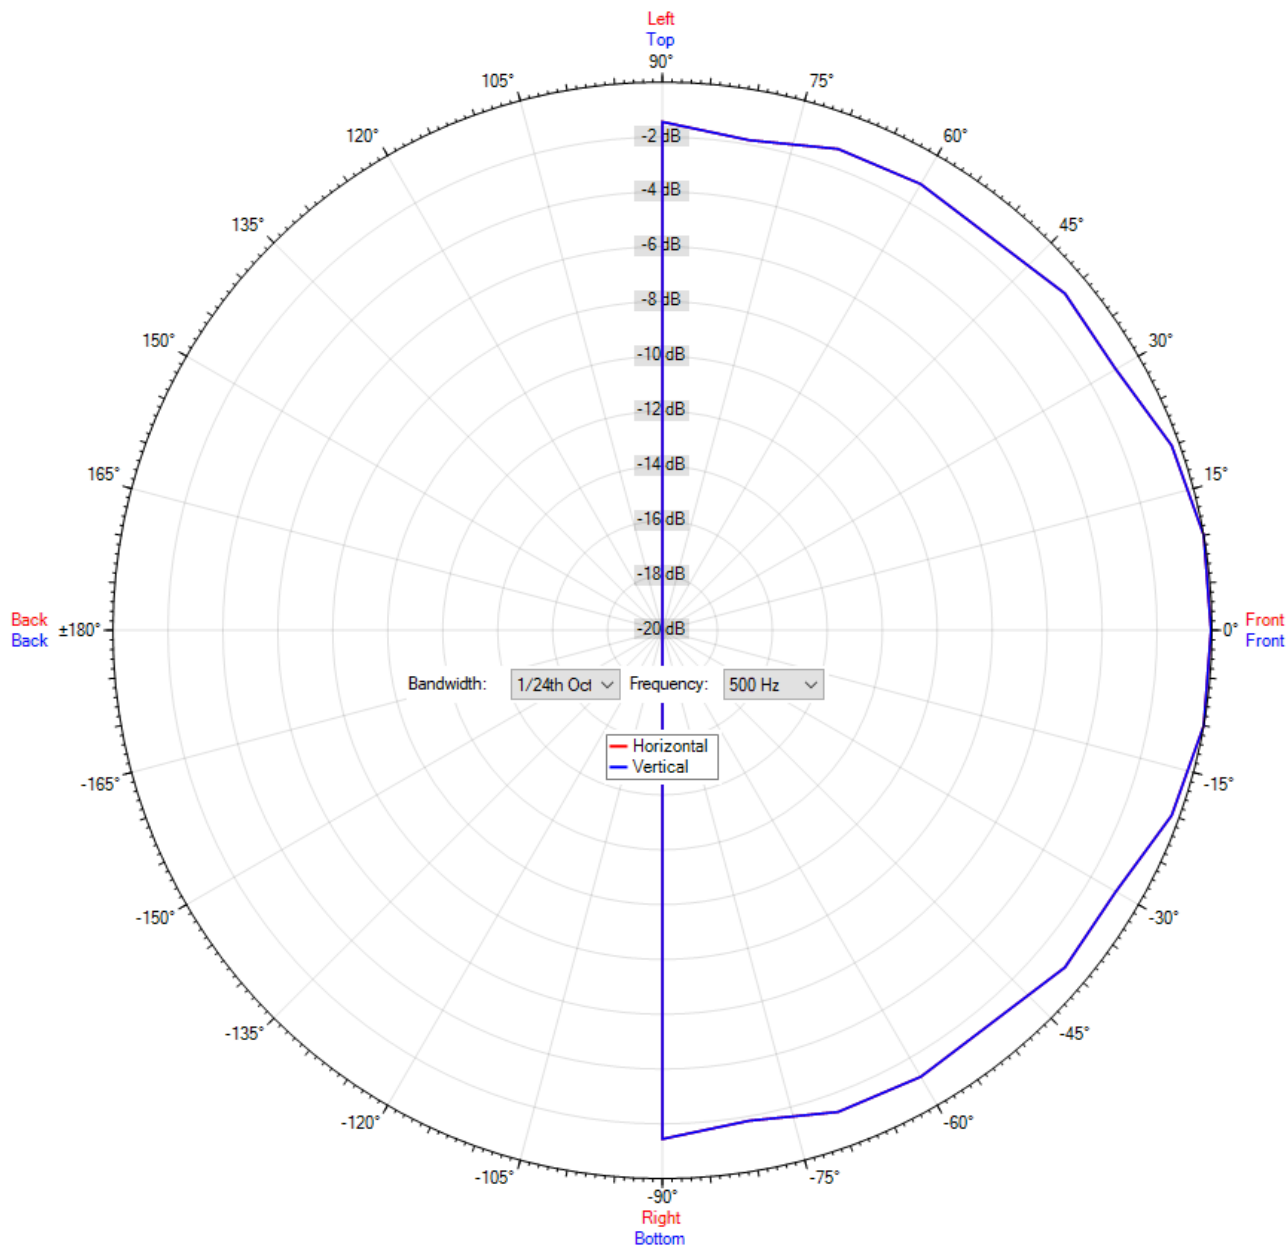

ic audio loudspeakers are tested and classified according to the IEC standard 60529 (degree of protection by enclosure) against the penetration of foreign objects and moisture. The classification is conforming to standards through characterization with a fixed code. This code consists of the letters IP (International Protection) followed by two digits. The first digit indicates the degree of protection against dust and the second digit the degree of protection against water. Please note that the testing of the products has been carried out in laboratory conditions which are not always 100% comparable with the conditions of different installation environments. This protection can be reduced due to normal wear and tear depending on the installation environment.

RoHS compliant (2011/65/EU)

The IP rating specified is based on ic audio test results, not on CNBOP-PIB test results. Certification only verifies the minimum requirements for EN54-24 compliance.

Article Nr.: 20194132

Packing Unit: 8

